


PLAN

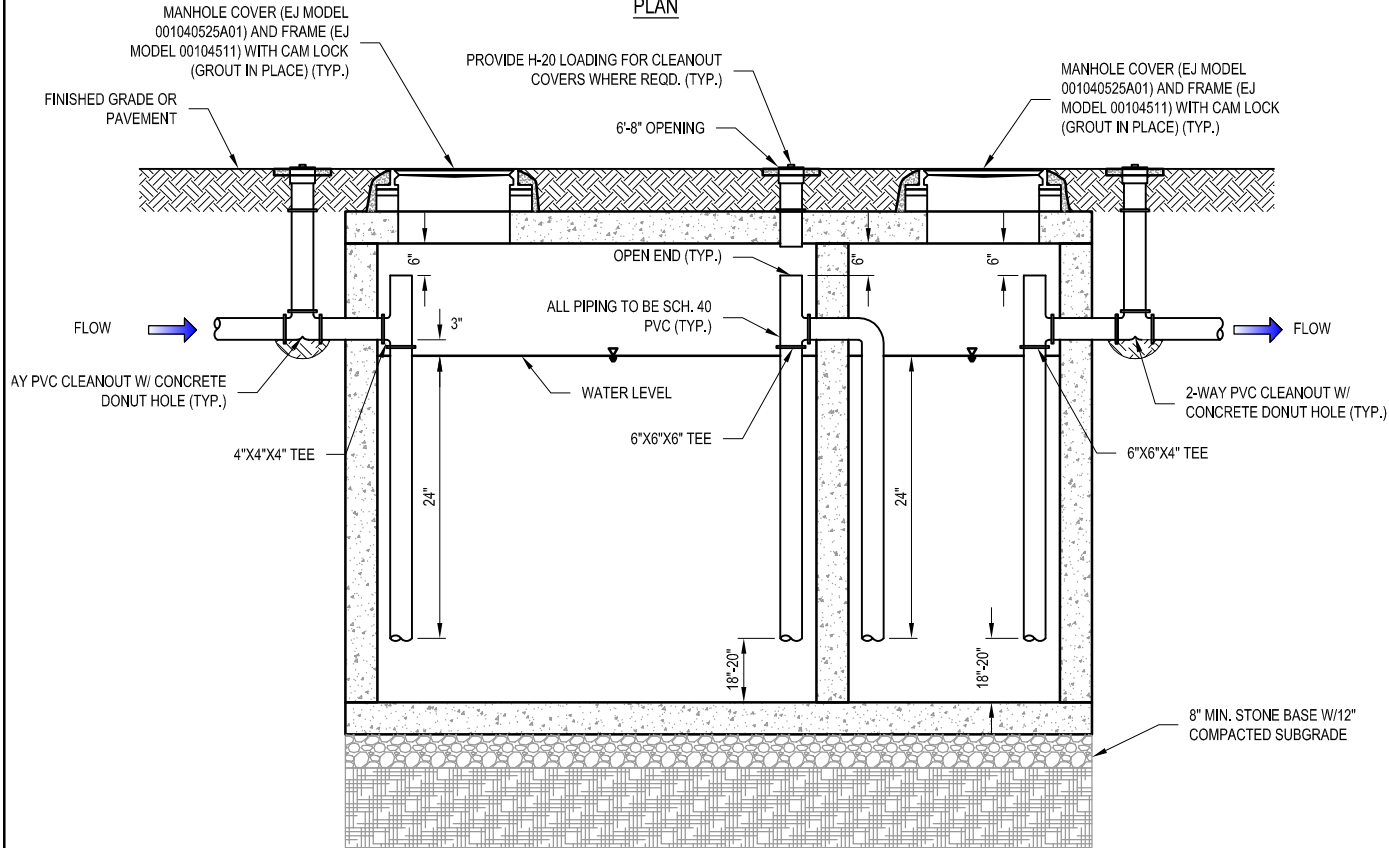

PROFILE

NOTES:

1. USE NON-SHRINK GROUT AT ALL PENETRATIONS.
2. PROVIDE BUTYL RUBBER SEAL BETWEEN ALL SECTIONS AND TOP
3. ALL TEES THROUGHOUT TANK MUST BE DWV PVC 40

| INTERCEPTOR DIMENSIONS | | |
|-----------------------------|-----------|------------|
| LIQUID CAPACITY (GALLONS) | WIDTH (W) | LENGTH (L) |
| 1,000 | 5'-1" | 8'-2" |
| 1,200 | 5'-9" | 8'-6" |
| 1,500 | 5'-7" | 10'-8" |
| 2,000 | 4'-11" | 15'-11" |
| OTHERS AS APPROVED BY OJRSA | | |

OCONEE JOINT REGIONAL SEWER AUTHORITY
FATS, OILS & GREASE INTERCEPTOR



DATE:
06/2022

DRAWING NO.:
FOG-2

REVISED:

SCALE:
NTS